

Power Quality Readings


Customer: **Sample Customer**

Date: 9/1/2008

Facility: **Sample Facility**

Server Room - Panel CB

Normal Power Harmonics - Neutral

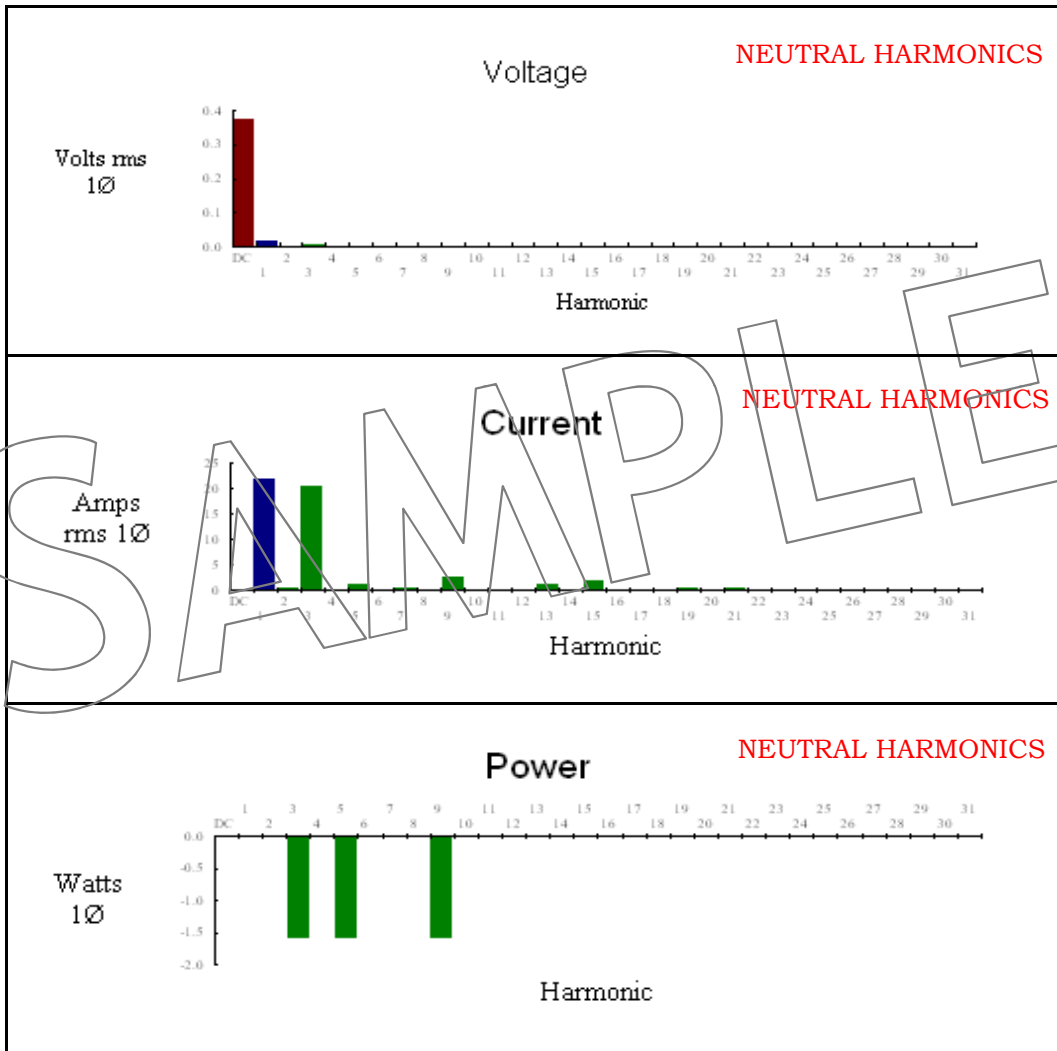

SAMPLE

DATA		COMMENTS
FREQUENCY	60	
NEUTRAL THDV	42.37	
NEUTRAL THDC	68.68	
NEUTRAL HRMS-V W	0.01	
NEUTRAL HRMS-C W	20.64	