


## Power Quality Readings

Customer:	Sample Customer	Date:	9/1/2008
-----------	-----------------	-------	----------

Facility:	Sample Facility	Panel FIDA
-----------	-----------------	------------

### Normal Power Voltage Readings

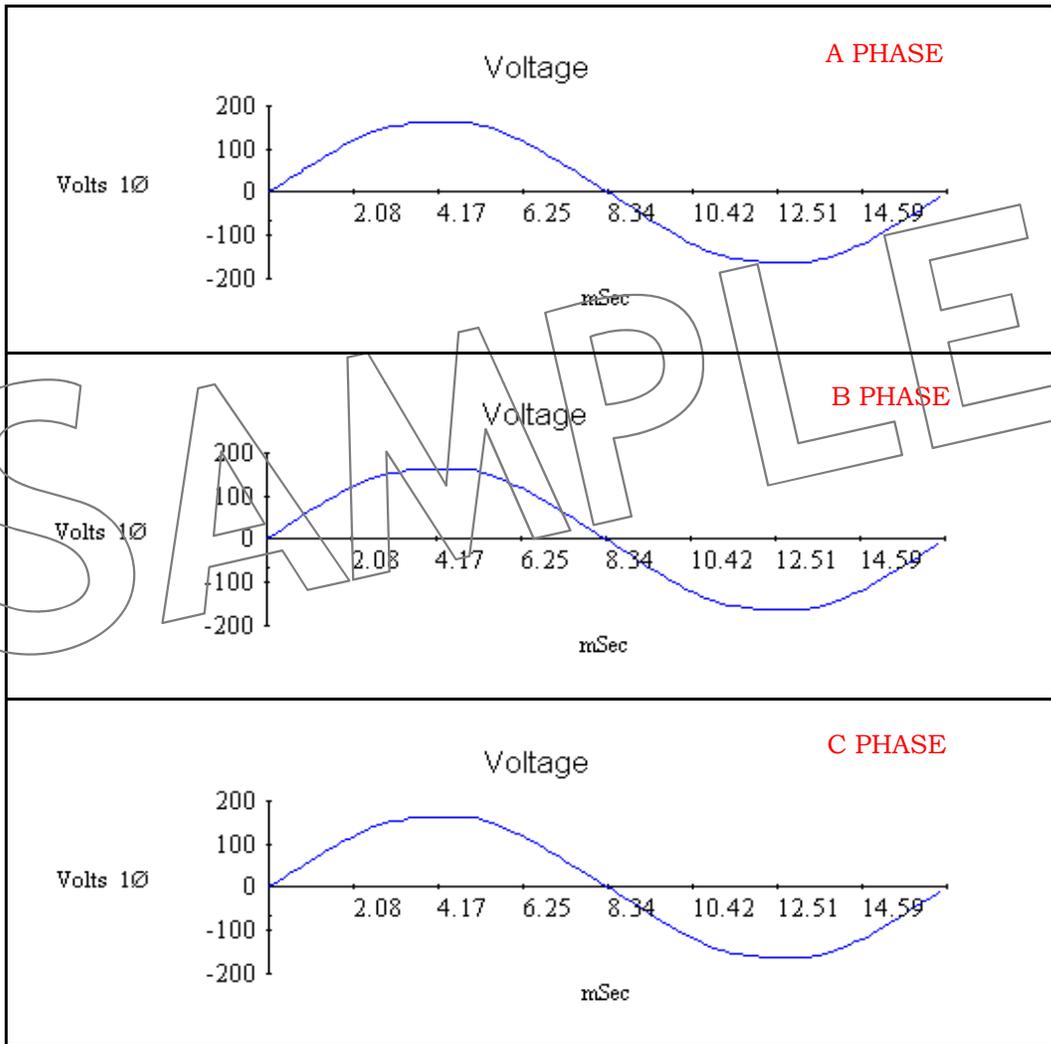

DATA		COMMENTS
FREQUENCY	60	Readings show that phase voltages are within limits. Voltage can vary within 5% of normal voltage (120V).
A PHASE RMS	117.95	
B PHASE RMS	118.40	
C PHASE RMS	117.83	
NEUTRAL RMS	0.38	