

## Power Quality Readings


Customer: **Sample Customer**

Date: 9/1/2008

Facility: **Sample Facility**

Panel **FIDA**

### Normal Power Voltage Harmonics

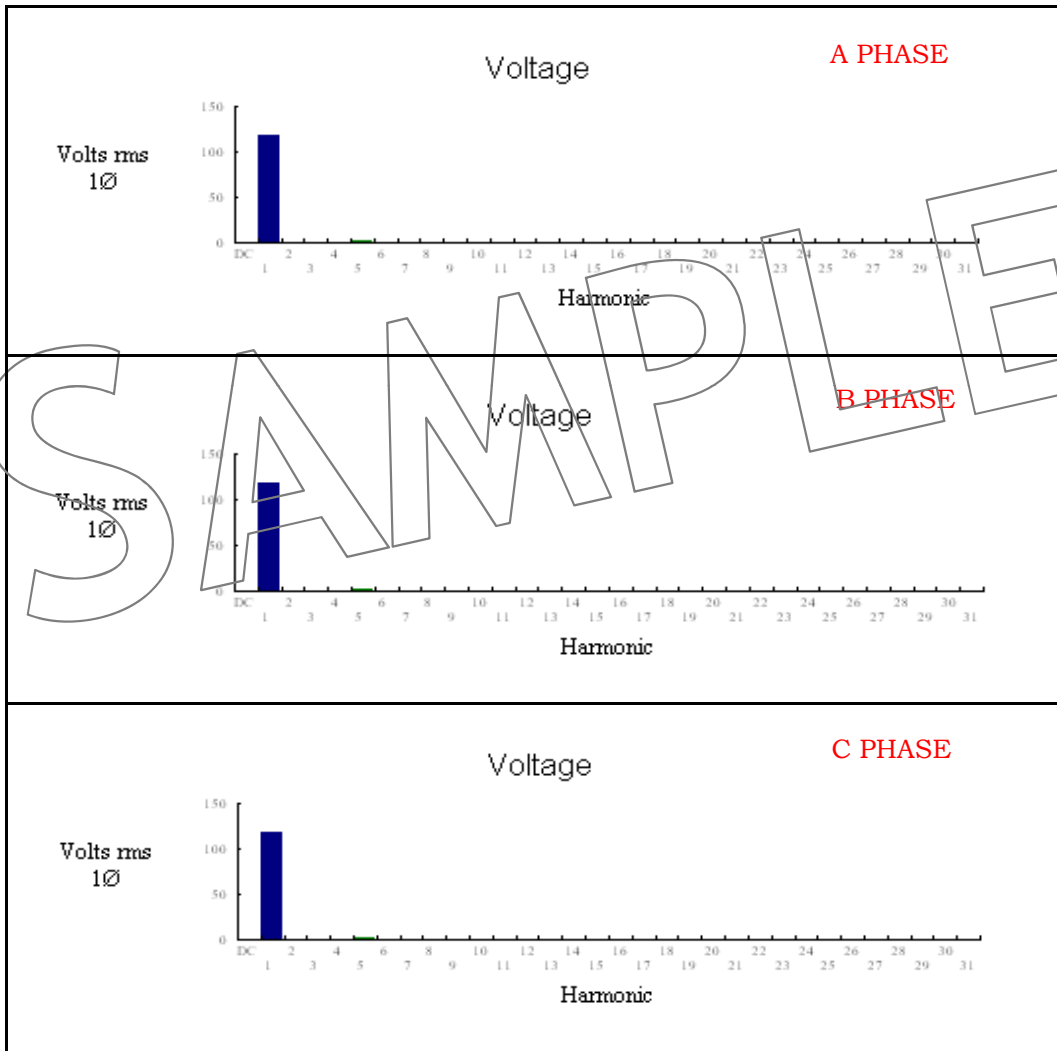

DATA		COMMENTS
FREQUENCY	60	Readings show that phase voltages have acceptable THDV (harmonics).
A PHASE THDV	1.41	
B PHASE THDV	1.54	
C PHASE THDV	1.49	
NEUTRAL THDV	44.11	